
Universal heating controller

- **DHR classic**
- **DHR comfort**
- **DHR expert**

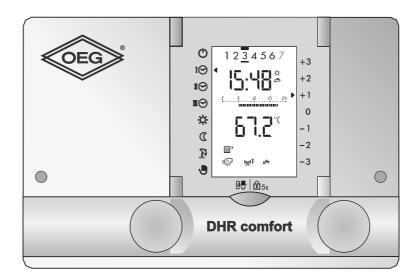

Operating manual

Dear User


This programmable heating controller is a modern device with a variety of functions, enabling optimal operation of a heating system offering a very high degree of comfort. Most of the necessary settings are made by a technician before the heating controller is used for the first time.

For this reason, you, the **user** of the heating system, should not be intimidated by this comprehensive instruction booklet! All the information you need to operate the controller is in the first part of the booklet. You will find that operation of the device is simple and logical.

Please read first the "Safety instructions" on page 7.

CONTROLS:


Functioning at User Level 1 (front cover closed)

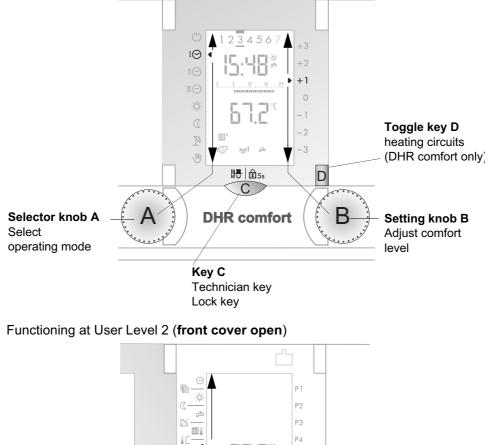




Overview of displays


The diagram shows a typical display in heating mode (Cover closed, User Level).

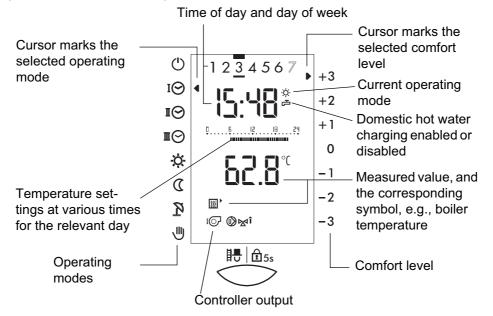

The diagram shows a display, with all the display symbols used for control. (cover open, User Level 2.).



DHR - comfort DHR expert



Dok. Nr. 112648 33/2010

Contents

| 1 2.1 2.2 2.3 2.4 | Safety instructions. Your heating controller . What the programmable controller does . User settings . Temperature information . Effectiveness of settings . | . 8 . 8 . 8 . 8 |
|---|---|--|
| 3 3.1 3.2 3.3 3.4 3.5 | First operating level. Selecting a heating circuit (two heating circuits) Selecting an operating mode. Adjusting room temperature heating operations Locking Measuring of emissions (chimney sweep service) | .9 10 11 11 |
| 4.13 | Displaying the controller output ports Displaying temperatures and values | 14 15 16 16 17 17 18 19 20 21 22 22 23 |
| | clock program (Example) | 26 26 26 28 28 |
| | | |

| | Setting the circulation pump clock program P1 |)) |
|-----|--|--------|
| | 4.18.2 Vacation program display/change/terminate | |
| 5 | Service level | 2 |
| 5.1 | Query operating data |) |
| 5.2 | Switching output functions on and off | |
| 5.3 | 3. Level | |
| 5.4 | Error message | |
| | 5.4.1 General information 35 | |
| 6 | Definitions | ; |
| 7 | Index | , |

1 Safety instructions

Regulatory compliance and safety information

This programmable controller is a modern electronic device.

C C This equipment complies with the following EC Directives:
73/23/EEC "Low Voltage Directive"

 89/336/EEC "Electro-Magnetic Compatibility (EMC) Directive", including amendment 92/31/EEC

The device is designed to be used with a heating appliance in accordance with the manufacturer's specifications.

No other type of usage is permitted.

Safety

This device uses state-of-the-art technology and conforms to the relevant safety regulations.

Danger

The device is electrically operated. Incorrect installation, or attempts by non-specialists to repair the device, may result in electric shocks, with fatal consequences. Installation and commissioning may be carried out only by appropriately qualified technical personnel. In general, the device and its accessories should not be opened up. Repairs should be carried out only by the manufacturer.

Instructions in this booklet that are marked with a warning symbol $\hat{\square}$ must be observed.

2 Your heating controller

2.1 What the programmable controller does

When correctly programmed, the device works in conjunction with an appropriate heating system to ensure that heating to the required temperature occurs during the programmed time-intervals. The available boilers (different forms of energy) are used environmental carefully and efficiently according to the necessary heat requirement.

2.2 User settings

As user, you can make the following settings:

- 3.1 Selecting a heating circuit (two heating circuits), page 9
- 3.2 Selecting an operating mode, page 10
- 3.3 Adjusting room temperature heating operations, page 11
- 3.4 Locking, page 11
- 4.2 Switching on the party function, page 15
- 4.3 Setting the time (clock), page 15
- 4.5 Setting the room temperature heating mode, page 16
- 4.6 Setting the room temperature for night reduction heating mode, page 17
- 4.7 Setting the warm water temperature, page 17
- 4.8 Adjusting the heating curve, page 18
- 4.9 Setting the maximum supply temperature, page 19
- 4.10 Setting the heating limit (summer/winter), page 19
- 4.12 Displaying temperatures and values, page 21
- 4.15 Setting the clock programs for heating/D.H.W., page 26
- 4.16 Setting an individual D.H.W. clock program P1, page 28
- 4.17 Setting the circulation pump clock program P1, page 29

All other adjustments should be made by technical personnel only. Faulty adjustments may lead to malfunctioning of the heating system or may shorten its life.

2.3 Temperature information

All temperature information is:

- if measured, in °C (Celsius)
- as temperature difference in K (Kelvin)

2.4 Effectiveness of settings

- 1. level: Modified settings become immediately effective
- 2. level: Modified settings become effective by changing the parameter or by closing the cover

3 First operating level

3.1 Selecting a heating circuit (two heating circuits)

The corresponding heating circuit must be selected each time before a function can be carried out. Depending on the heating circuit selected, the switch key shows either "red" or "green".

| Operating step | Operation | Display |
|--|-----------|--------------------------------------|
| Press the key D to select the correct heating circuit "green " or "red "! | D | Standard display D appears |

Your heating expert can tell you which colour refers which heating circuit. This can then be noted here:

| Note reference: | 1 (green) | 2 (red) |
|-----------------|-----------|---------|
| Heating circuit | | |
| Generator | | |

3.2 Selecting an operating mode

Set using the knob (A

The arrow to the left in the display shows the selected operating mode. Example front view: The setting $i \bigcirc$ becomes valid immediately.

| | | Explanation | ı | | | |
|--------|--|--|-----------------------|----------------------|------------------------------------|--------------------------------------|
| Symbol | Operating mode | in accordance with clock pro- gram | continu- ously OFF | continu- ously ON | continu- ous heating mode | continu- ous reduction mode |
| Ċ | Heating OFF (Standby) | | 山目 | | | |
| ΙΘ | Clock program I | | | | | |
| ПÔ | Clock program II | Щ С ⁽¹ | | | | |
| ШO | Clock program III | | | | | |
| .☆. | Heating mode | | | Ъ | Ш | |
| Q | Reduced heating mode | | Ъ | | | Ш |
| R | Summer mode | | Ш | | | |
| | Manual mode <u>A</u> Emergency mode | | | Ъ | Ш | |

Legend:

| Ш | Heating mode |
|---|-------------------------|
| Ъ | Domestic hot water mode |

Note: In all operating modes the freeze protection is guaranteed. Heating limits can switch the heating enterprise off. On operating mode "Manual/Emergency" please call the specialist.

1) you can define your own domestic hot water-heating program.

3.3 Adjusting room temperature heating operations

| Operation step | Operation | Display |
|---|-----------|---|
| Ambient temperature increase Example: +1.5 °C | В | 1⊙ 1⊙ 1⊙ 1⊖ +2 1⊙ 1⊙ 1⊙ 1⊖ +1 |
| Ambient temperature decrease Example: - 3,0 °C (save, absence) | (B) | ∑ ∭ |

The arrows to the right in the display show the adjusted temperature settings for $\dot{\phi}$. (heating . The adjustment becomes valid immediately.

3.4 Locking ⊕_{5s}

The lock prevents unintentional changes of settings. The lock applies **to both hea-ting circuits/boilers at the same time** and includes all functions, except "measuring of emissions"

| Operation step | Operation | Display |
|-----------------|----------------------------|---|
| Activate lock | 1€ 1 15s C 5 seconds | IO I. II IO III IIII IO IIIII IO IIIIIIIIIIIIIIIIIIIIIIIIIIIIIIIIIIII |
| Deactivate look | E I I 5s C 5 seconds | II⊙ III⊙ III⊙ III⊙ ☆: JE 5°C -1 Q III⊙ -2 |

3.5 Measuring of emissions (chimney sweep service)

| Operation step | Operation | Display | | |
|---------------------------------|--------------|--|--|--|
| Activate emission measurement | E 1 55s | 10 10 10 10 10 10 10 10 10 10 | | |
| Deactivate emission measurement | Brain Base C | Standard display 1st level appears | | |

Note: Following activation of this function, heating is controlled according to the set maximum temperature. Operation of this function for measuring emissions is limited to 20 minutes and must be reactivated after this time if required.

4 Settings 2nd level (Cover open)

Incorrect changes to the settings may cause the heating system to malfunction or shorten its life.

| Sym- bol | Function to be set | Factory settings | Setting range | Basic adjustment | Adjustment | Unit |
|-------------|--|---------------------|------------------|---------------------|------------|-------|
| Θ | "Setting the time (clock)"; page 15 | pre- sent * | - | | | h/m |
| 131 | "Setting the date"; page 16 | pre- sent * | until 2079 | | | M/T/J |
| ò. | "Setting the room temperature heating mode"; page 16 | 20 | 10÷30 | | | °C |
| ۵ | "Setting the room temperature for night reduction heating mode"; page 17 | 15 | 5÷20 | | | °C |
| æ | "Setting the warm water temperature"; page 17 | 55 | 10÷70 | | | °C |
| X | "Adjusting the heating curve"; page 18 | 1.2 | 0.0÷5.0 | | | - |
| # % | "Setting the maximum supply tempe- rature"; page 19 | 70 | 10÷90 | | | °C |
| ۶Ĺ | "Setting the heating limit (summer/win- ter)"; page 19 | 18 | 0÷40 | | | °C |

| Sym- bol | Function to be set | Unit |
|-------------|---|------|
| i | "Displaying temperatures and values"; page 21 | ů |
| 0 | "The standard clock programs (factory settings)"; page 23 "Setting the clock programs for heating/D.H.W."; page 26 | - |
| ⊘⊭ | "Setting an individual D.H.W. clock program P1"; page 28 | - |
| ΘØ | "Setting the circulation pump clock program P1"; page 29 | - |
| Ô | "Vacation program"; page 30 | - |

Dok. Nr. 112648 33/2010

13

| Sym- bol | Function to be set | Unit |
|-------------|--|------|
| Ś | Service level | - |
| | Access code For technicians only | - |
| Ϋ́Υ | "Switching on the party function"; page 15 An active vacation program is deleted | - |
| RESET | Restarts the controller. No settings are changed! | - |
| CLR | "Transfer the value to the standard display (1st level)"; page 22 "Reload of standard clock programs preset at the factory"; page 25 Reset the operational data , see "5.1 Query operating data", page 32 | - |

* Clock reserve PM 2970/72 = 24h; PM 2975 = 2 years

4.1 Unlock during error message (TEM firing automatic)

If a firing automatic of a solid boiler is integrated in the plant, a possible error message can be acknowledged.

| Ор | eration step | Operation | Display |
|----|---|-------------|---------------------------------------|
| 1 | Select generator | D | |
| 2 | Open front cover Unlock: Keep the key C pressed until the burner symbol lights up briefly. | УY С | |
| 3 | If the error was successfully repai- red, the controller turns back to the standard display within max. 3 minutes. | Close cover | Standard display 1st level appears |

4.2 Switching on the party function YY

| peration step Operation Display | | |
|---------------------------------|---------|--|
| Activate party function | Ч С | Image: Constraint of the second s |
| Deactivate party function | YY C | Standard display 1st level appears |

Note:The party function becomes valid for 3 hours from the start of the next
night reduction heating phase according to clock program.Image: Image: Image: An active vacation program is by activating the party function de-
leted!

4.3 Setting the time (clock)

| Operation step | Operation | Display | | |
|-------------------------|-----------|--------------------------|--|--|
| Select the function | A | | | |
| Set the time | В | © | | |
| Select another function | | The selected function or | | |
| or close the cover | | the standard display | | |
| The setting is stored | | appears | | |

Note: Change from winter time to summer time, and vice versa, is made automatically on the last Sunday of March and again in October. If the controller is not connected to the line, no automatically change happens. As soon as the controller is connected to the line, change happens the following day between 2.00 and 3.00 o'clock a.m.

4.4 Setting the date 🛅

A calendar program is available. This is programmed to the year 2099, and takes leap years into account.

| Operation step | Operation | Display |
|---|-----------|---|
| Select date Example: October 24, 2003 | A | Day $\square \bigcirc (1 2 3 4 5 6 7)$ $\square \bigcirc (1 2 3 4 5 7)$ $\square \bigcirc (1 2 3 4 7)$ $\square \bigcirc (1 2 3 4 7)$ $\square \bigcirc (1 2 3 4 7)$ $\square \bigcirc (1 2 3 7)$ $\square \bigcirc (1 2 7)$ $\square \bigcirc (1 2 7)$ $\square \bigcirc (1 2 7)$ $\square \bigcirc (1 $ |
| Set the date Example: November 09, 2003 | В | ○ 1 2 3 4 5 6 7 P1 ○ ↓ ↓ ↓ ○ ↓ ↓ ↓ |
| Select another function | | The selected function or |
| or close the cover | | the standard display |
| The setting is stored | | appears |

Note: On setting the date, the day of the week is indicated as follows:

1 = Monday, 2 = Tuesday, 3 = Wednesday, 4 = Thursday, 5 = Friday, 6 = Saturday, 7 = Sunday

4.5 Setting the room temperature heating mode 🔅

| Operation step | Operation | Display | |
|---|-----------|---|--|
| Select function | A | © (□ (− - P1 P2 | |
| Set the selected room temperature. Example: Heating 20.0 °C The setting becomes valid immediately! | В | | |
| Select another function or close the cover The setting is stored | | The selected function of the standard display appears | |

4.6 Setting the room temperature for night reduction heating mode ((

| Operation step | Operation | Display |
|---|-----------|---|
| Select function | A | © () () () () () () () () () () |
| Set the room temperature for night reduction heating. Example: reduced heating 18.0 °C The setting becomes valid immediately! | В | |
| Select another function or close the cover The setting is stored | | The selected function or the standard display appears |

4.7 Setting the warm water temperature 📇

| Operation step | Operation | Display | | |
|--|-----------|---|--|--|
| Select function | A | Q ₽2 ▷ ₽2 ▷ □ □ □ | | |
| Set the domestic warm water temperature. Example: DHW 55.0 °C | В | | | |
| Select another function or close the cover The setting is stored | | The selected function or the standard display appears | | |

The warm water boiler is now controlled by this temperature.

1 Changes should be discussed with a qualified technician.

4.8 Adjusting the heating curve 🖄

| Operation step | Operation | Display | | |
|---|-----------|---|--|--|
| Select function | A | (1) (2) | | |
| Set the heating curve. Example: Heating curve 1.2 | В | ¹ ¹ ¹ ⁰ [−] ⁰ [−] ⁰ [−] ¹ [−] | | |
| Select another function | | The selected function or | | |
| or close the cover | | the standard display | | |
| The setting is stored | | appears | | |

Due to the deviation of room temperature to outside temperature each time, changes should be made as follows:

| Outside | Room temperature | | | |
|-------------------------------|---|--|--|--|
| temperature during the day | too cold | too warm | | |
| +5 until +15 °C | Set slope of heating curve \bowtie to - 0.2 and base \measuredangle to + 5 K. | Set slope of heating curve \bowtie to + 0.2 and base \clubsuit to - 5 K. | | |
| -20 until +5 °C | Set slope of heating curve ⊠ to + 0.2 | Set slope of heating curve ⊠ to - 0.2. | | |

Changes are only processed slowly by the building. For this reason, only one change should be made per day.

4.9 Setting the maximum supply temperature

| Operation step | Operation | Display | | |
|---|-----------|---|--|--|
| Select function | A | | | |
| Set the maximum supply temperature. Example: maximum supply tempera- ture 55 °C | В | © □ □ □ □ □ □ □ □ □ □ □ □ □ □ □ □ □ □ □ | | |
| Select another function or close the cover The setting is stored | | The selected function or the standard display appears | | |

The maximum supply temperature is limited to the set value.

This is not a safety feature. Safety (protection against overheating) must be ensured by a qualified technician.

4.10 Setting the heating limit (summer/winter) **4**

Average outside temperature is upper as i = heating "OFF"Average outside temperature is lover as (i = 2 K) = heating "ON"

| Operation step | Operation | Display | | |
|---|-----------|--|--|--|
| Select function | A | | | |
| Set the heating limit. Example: heating limit 20 °C | В | Imid Imid P4 ○mmid Imid Imid P4 ○mmid Imid Imid P5 | | |
| Select another function | | The selected function or | | |
| or close the cover | | the standard display | | |
| The setting is stored | | appears | | |

Note: The heating limit in night reduction period can be adjusted on the setting 3-2.

4.11 Displaying the controller output ports

Depending on the state of the unit and the operating mode, some of these symbols will be shown.

| | Designation | | DHR - classic | DHR - c | omfort | DHR - expert | | |
|------------|---|----|---------------|------------|----------|--------------|----------|--|
| Symbol | heating circuit/generator (1=green; 2=red) | | | 1 green | 2 red | 1 green | 2 red | |
| | Modulation heat gene- rator | FA | х | Х | х | х | х | |
| IQ | Generator I or burner stage I | b1 | х | х | | х | | |
| QI | Burner stage II | b2 | х | х | | х | | |
| ⊠î | Heating circuit mixing valve open | M+ | х | х | | х | Х | |
| ⊠î | Heating circuit mixing valve closed | M- | х | Х | | х | Х | |
| \bigcirc | Heating circuit circula- tion pump | U | х | х | х | х | Х | |
| æ | Charging pump/deflec- tor valve | | х | X | | x | | |
| \bigcirc | O Circulation pump DHW C | | | | | × | х | |

| Operating manual |
|--|
| DHR - classic DHR - comfort DHR - expert |

| 4.12 | Displaying | temperatures | and values ${f i}$ |
|------|------------|--------------|--------------------|
|------|------------|--------------|--------------------|

| Operation step | Operation | Display |
|---|-------------------|--|
| Select the heating circuit or generator (in case of setting on 7-0) | D | |
| Select function | A | 1 2.3 P4 ○□□□□□□□□□□□□□□□□□□□□□□□□□□□□□□□□□□□□ |
| Displaying of temperatures and values Example: outside temperature 2.3 °C | В | Image: |
| Displaying actual value | В | $\begin{array}{c c} & & & & \\ \hline & & & \\ \hline \\ \hline$ |
| Displaying set and actual values | B turn quickly | |
| Select another function or close the cover | | The standard display appears |

4.12.1 Set values and actual values 5011 51

Actual value = measured value

Set value = control value (by turning the setting knob **B** quickly) Displaying the actual temperatures serves to check the sensors.

| Symbol | Designation | Key | Abbr. | | Disp | olay |
|------------|--|-------|-------|----|------|-------------|
| | Boiler flow temperature WEZ 1 | green | TK 1 | °C | Soll | 15 F |
| ₽₿ | Domestic hot water temperature | | ΤВ | °C | Soll | 15 F |
| í | Room temperature 1 | green | TI 1 | °C | Soll | 15 F |
| Î | Room temperature 2 | red | TI 2 | °C | Soll | ¦5⊦ |
| • | Heating circuit supply flow tem- perature 1 | green | TV 1 | °C | Soll | <u>ا</u> 5۲ |
| • | Heating circuit supply flow tem- perature 2 | red | TV 2 | °C | Soll | <u>ا</u> 5۲ |
| | Averaged outside temperature | | TA | °C | | |
| ↓ L | Actual outside temperature | | ТА | °C | | <u>ا</u> 5۲ |




If the sensor configurations were saved at start-up, defective sensors will be shown to register 120 °C. Exception: TA = 0 °C.

4.13 Transfer the value to the standard display (1st level)

- 1. Select the desired value as explained before.
- 2. Press **CLR** key with a thin object.

Press **CLR** key with a thin object



3. Close the cover. The desired value is now shown in the standard display.

4.14 The standard clock programs (factory settings)

I⊙ P1 = Clock program 1, standard domestic program

| Blocks of days | | Heating and (domestic hot water) | | | | r) |
|----------------|-----------------|----------------------------------|---------|------|-------|------|
| Weekday | Marked days | \$ | (🗗) | Note | () | Note |
| Mo-Fr | <u>12345</u> 67 | 06.00 | (05.00) | | 22.00 | |
| Sa-So | 12345 <u>67</u> | 07.00 | (06.00) | | 23.00 | |

| I⊙ P2 = Clock program | 2, heating with reduced periods on | working days |
|-----------------------|------------------------------------|--------------|
| | | |

| Blocks | of days | Н | eating and | l (domesti | c hot wate | r) |
|---------|------------------|-------|------------|------------|------------|------|
| Weekday | Marked days | \$ | (🗗) | Note | () | Note |
| Mo-Do | 10076/7 | 06.00 | (05.00) | | 08.00 | |
| 10-00 | 1234567 | 15.30 | (14.30) | | 22.00 | |
| Fr | 100/7/7 | 06.00 | (05.00) | | 08.00 | |
| | 1234 <u>5</u> 67 | 15.30 | (14.30) | | 23.00 | |
| Sa | 12345 <u>6</u> 7 | 07.00 | (06.00) | | 23.00 | |
| So | 123456 <u>7</u> | 07.00 | (06.00) | | 22.00 | |

$\square \odot$ P3 = Clock program 3, offices and industrial premises

| Blocks | of days | н | eating and | l (domesti | c hot wate | r) |
|---------|-----------------|----------|------------|------------|------------|------|
| Weekday | Marked days | ☆ | (🗗) | Note | (运 | Note |
| Mo-Fr | <u>12345</u> 67 | 06.00 | (05.00) | | 19.00 | |
| Sa-So | 12345 <u>67</u> | - | - | | continu. | |

⊘ P1 = Separate clock program of domestic hot water

| Blocks of day | Domestic hot water | | | |
|---------------|--------------------|------|-------|------|
| Weekday 🗲 | | Note | 运 | Note |
| Mo-So | 00.00 | | 00.00 | |
| Note | | | | |
| Note | | | | |

Note: There is no individual DHW program preset at the factory.

$\odot \odot$ P1 = Clock program of circulation

| Blocks of days | Circulation pump | | | | |
|----------------|------------------|------|-------|------|--|
| Weekday | ē | Note | 冱 | Note | |
| Mo-So | 06.00 | | 08.00 | | |
| Mo-So | 11.30 | | 13.30 | | |
| Mo-So | 17.00 | | 21.00 | | |

Note: ☆ = start clock program (start of heating in according with setting 3-6). The clock program of domestic hot water starts ever 1 hour first of the heating program.

4.14.1 Cooperation of the standard and the individual D.H.W. clock program (Example)

| Operating mode 1st Level | Standard clock program domestic hot water P1/P2/P3 ⊙∰ factory setting = on | Individual D.H.W. clock program P1 ⊙⊄ There is no individual DHW program preset at the factory | active clock program | |
|--------------------------------|---|---|-------------------------|--|
| | on = active off = inactive see "4.16.1, page 28 | always active see chapter "4.16.2, page 29 | | |
| I⊙ P1 | om ⊭ on /off | ⊝ P1 | i⊝ + ⊝⊭ | |
| ∎⊙ P2 | ⊘ Ⅲ ढ़ on/ off | ⊝ P1 | ⊘⊳ | |
| ¤⊝ P3 | ⊙ttt i i i i i i i i i i i i i i i i i i | ⊝ P1 | ⊪⊘ + ⊘≓ | |

With position "**off**" only the individual domestic hot water clock program P1 is active. With position "**on**", the two clock programs (standard/individual) overlay, i.e. both clock programs are active at the same time.

4.14.2 Reload of standard clock programs preset at the factory

The standard clock programs preset at the factory can be reloaded at any time, see "4.14 The standard clock programs (factory settings)", on page 23.

| Ор | eration step | Operation | Display |
|----|--|--------------|---|
| 1 | Open cover Select function | A | Come P4 Come P4 Come P4 P5 P6 P6 |
| 2 | Select program P1 until P3 Example: Program P3 | В | |
| 3 | Display clock program Example: Program P3 | (A) | |
| 4 | Press CLR key with a thin object | RESET CLR YY | RESET CLR YY |
| 5 | Close cover, the standard clock program is reloaded | Close cover | The standard display appears |

4.15 Setting the clock programs for heating/D.H.W. ⊙

A clock program defines the periods during which the room temperature or domestic hot-water temperature (DHW temperature charging starts one hour earlier) should correspond to the set temperature.

| Ор | eration step | Operation | Display |
|----|--|-----------|---------|
| 1 | Select heating circuit (in case of setting on 7-0) | D | |
| 2 | Open cover Select function | A | |
| 3 | Select program P1 until P3 Example: Program P3 | В | |
| 4 | Display clock program Example: Program P3 | | |

4.15.1 Checking the clock program for heating/D.H.W. mode

4.15.2 Changing the clock program for heating/D.H.W mode

| Ор | eration step | Operation | Display |
|----|-------------------------------|-----------|--|
| 1 | Open cover Select function | A | Image: Constraint of the second se |
| 2 | Select heating circuit | D | |

| Ор | eration step | Operation | Display |
|----|--|------------|--|
| 3 | Select program P1 until P3 Example: Program P3 | В | Image: Second |
| 4 | Activate changes Example: Program P3 | (A) 2 x | [⊕] |
| 5 | Select block (or day of the week) and time for which the setting app- lies ("starting point"). Fast rotation accelerates setting. | В | ○ 1 2 3 4 5 6 7 P1 ○ ○ 0 0 ○ ○ 0 0 ○ □ 0 0 ○ □ 0 0 ○ □ □ 0 ○ □ □ 0 ○ □ □ 0 ○ □ □ 0 ○ □ □ 0 |
| 6 | Change between night reduction heating and heating mode | | |
| 7 | Set the heating period The black segments will be added | В | ○ 1234567 ○ 1234567 ○ ○ <tr< td=""></tr<> |
| 8 | Select set night reduction heating period | (A) | |
| 9 | Set the night reduction heating period Black segments, if any are marked, will be deleted. | В | |

| Ор | eration step | Operation | Display |
|----|--|-------------------|---|
| 10 | Select new day/period for further changes. Repeat steps as given above. | (A) | ⊕ ⊕ |
| 11 | Leave function The finished clock program is now saved. The program can now be checked again, or will be saved when the cover is closed. The standard display appears. | or close cover | |

Note: The shortest period to be set for heating mode is 30 minutes.

4.16 Setting an individual D.H.W. clock program ⊙ ₽ P1

Note: Only the clock program P1exists.

4.16.1 Separating the clock program D.H.W. from the standard clock program heating

To program and activate an individual D.H.W. clock program, it must be separated from the standard clock program for heating.

| Ор | eration step | Operation | Display |
|----|---|------------|---|
| 1 | Select heating circuit (in case of setting on 7-0) | D | |
| 2 | Open cover Select function | A | |
| 3 | Select program P1 until P3 Example: Program P3 | В | Image: Second |
| 4 | Select function: Factory setting P1 - P3 is "on" on = D.H.W. according to "Setting the clock programs for heating/ D.H.W."; page 26 | (A) 1 x | Image: mail of the second |

| Op | peration step | Operation | Display |
|----|---|-----------|---------|
| 5 | off = D.H.W "AUS" or individual D.H.W. clock program ⊙⊯ is active | В | |

Note: If the individual D.H.W. clock program is not separated, it overlaps with the standard clock program of heating and both are active.

4.16.2 Display and change the individual D.H.W. clock program

| Operation step | Operation | Display |
|-----------------|-----------|---------|
| Select function | A | |

Further control steps:

"4.15.1 Checking the clock program for heating/D.H.W. mode", on page 26, and "4.15.2 Changing the clock program for heating/D.H.W mode", on page 26. The symbols in the display 声
c apply to change between an active and inactive domestic hot water charge.

4.17 Setting the circulation pump clock program $\bigcirc \bigcirc$ P1

Note: Only the clock program P1exists.

4.17.1 Display and change the circulation pump clock program

| Operation step | Operation | Display |
|-------------------------------|-----------|---------|
| Open cover Select function | A | |

Further control steps:

"4.15.1 Checking the clock program for heating/D.H.W. mode", on page 26, and "4.15.2 Changing the clock program for heating/D.H.W mode", on page 26.

The symbols in the display $rac{1}{2}$ $rac{1}{2}$ apply to change between an active and inactive circulation pump.

4.18 Vacation program 💼

With the vacation program only room protection heating is active (adjuster 3-0), the domestic hot water is switched off. For programming, only the date for the vacation program's end must be set. The vacation program begins at 24:00 o'clock on the day of its setting. The vacation program ends at the change of date (midnight 12:00 p.m.).

Pressing the "Party Key" cancels an active vacation program.

| Ор | eration step | Operation | Display |
|----|---|-------------|---|
| 1 | Select heating circuit (in case of setting on 7-0) | D | |
| 2 | Select function | A | □ ☆ P2 ○ □ P3 ○○ □ P5 ○○ □ P6 ◇ P7 |
| 3 | Set the date of end of vacation. | В | ○ 1 2 3 4 5 6 7 P1 ○ ○ 0 P2 ○ ○ 0 P4 ○ ○ 0 P6 ○ ○ 0 0 |
| 4 | Leave function The finished vacation program is now saved. The vacation program becomes active starting from 24:00 o'clock. | Close cover | Standard display appears |
| 5 | As soon as the vacation program is active, a cursor flashes in the case of the symbol را | | Ů * 12 <u>3</u> 4567 1⊗ ↓↓↓ +3 +2 |

4.18.1 Setting the vacation program

4.18.2 Vacation program display/change/terminate

| Ор | eration step | Display | |
|----|--|-------------|--|
| 1 | Select heating circuit (in case of setting on 7-0) | D | |
| 2 | display: Select function The end of the vacation program appears | A | ○ 1 2 3 4 5 6 7 P1 ○ ○ 0 P2 ○ 0 0 P3 ○ 0 0 P4 ○ 0 0 P6 |
| 3 | change: Change the date of vacation end | (B) | □ 1 2 3 4 5 6 7 P1 □ □ 0 0 □ □ 0 0 □ □ 0 0 □ □ 0 0 □ □ 0 0 □ □ 0 0 □ □ 0 0 □ □ 0 0 |
| 4 | terminate: Turn with adjusting knob B to the left side until appears "" The vacation program is deleted or | В | Image: Control of the second seco |
| 5 | the vacation program can also be deleted with the Party key. | YY C | RESET CLR YY |
| 6 | Leave the function | Close cover | The standard display appears |

5 Service level관

5.1 Query operating data

The operation hours and switching cycles of the burner stages as well as further data can be queried.

| Operation step | Operation | Display |
|--|-------------|--|
| Select generator (in case of setting on 9-0) | D | |
| Select service level | A | |
| Select function "dat" | (B) 1 x | |
| Query data Example: Operation hours of the bur- ner stage I = 12'034 hours | | Image: Constraint of the second s |
| Leave the function | Close cover | The standard display appears |

| Operating of | Operating data | | Unit |
|--------------|---------------------------------|-------|------|
| IQ | Operating hours burner stage I | green | h |
| IQ | Switching cycles burner stage I | green | |

5.2 Switching output functions on and off

This function is reserved for technicians only!

This function serves for testing output functions. Each output function may be selected and switched on or off. The system can be tested to check whether the switched-on output function is correctly executed.

| Operation step | Operation | Display |
|---|------------|---|
| Select heating circuit (in case of setting on 7-0) | D | |
| Select service level | A | • [⊥] • • • • • • • • • • • • • |
| This function is reserved for techni- cians only! | (B) 2 x | [*] ⁻ ¹ ⁻ ⁻ ⁻ ⁻ ⁻ ⁻ ⁺ ⁻ ⁻ ⁺ |
| Select another function or close the cover | | The standard display appears |

5.3 3. Level

This function is reserved for technicians only!

| Operation step | Operation | Display |
|---|-----------|--|
| Select heating circuit (in case of setting on 7-0) | D | |
| Select service level | A | *└ *Ì ♡▥━━ ♡◎━━ � ♥ ₽6 ₽7 |
| This function is reserved for techni- cians only! | B) 1 x | Image: Constraint of the second s |
| Select another function or close the cover | | The standard display appears |

5.4 Error message

5.4.1 General information

In case of an error the backlight of the display switches on. On level 1 (cover closed) in place of the time the display appears "Er 1... 8", in place of the selected temperature - an error-number "00 to 99" or "-".

The display Er 1... 8 describes the cascade level in which the boiler is incorrect: Fr 1 = Generator

| eBUS-error Short-circuit in the eBUS wiring | $ \begin{array}{c} \textcircled{0} \\ I \end{matrix}{0} \\ I \textcircled{0} \\ I \end{matrix}{0} \\ I \textcircled{0} \\ I \textcircled{0} \\ I \textcircled{0} \\ I \textcircled{0} \\ I \end{matrix}{0} \\ I \textcircled{0} \\ I \textcircled{0} \\ I \end{matrix}{0} \\ I \textcircled{0} \\ I \textcircled{0} \\ I \end{matrix}{0} \\ I \textcircled{0} \\ I \end{matrix}{0} \\ I \end{matrix}{0} \\ I \textcircled{0} \\ I \end{matrix}{0} \\ I \end{matrix}{0}$ |
|--|---|
| Disturbance of an external firing automat over eBUS The error code in the lower display-line is product dependent. The meaning is to be inferred from the operating instructions of the firing automat. | $ \begin{array}{c} \textcircled{0}\\ 1 & 2 & \underline{3} & 4 & 5 & 6 & 7 \\ 1 & & & & & & \\ 1 & & & & & & \\ 1 & & & &$ |

6 Definitions

| Start of occupation | The start of the occupation period, as programmed on the timer. |
|-------------------------------|--|
| Occupation period | The period of time for which the system is heated to normal temperature. |
| Technician levels | These setting levels are reserved for technicians. They contain setting parameters for adaptation of the controller to the heating system. |
| Heating-curve adapta- tion | Automatic adaptation of the heating curve for the building. |
| Actual value | The measured temperature. |
| Optimisation | Automatic advancing of the time at which heating is to begin, in accordance with the heating requirement. |
| Setpoint | Temperature, defined by user or technician, to which the heating controller regulates the actual temperature. |

Operating manual

DHR - classic DHR - comfort DHR - expert

7 Index

Α

| Adjusting room temperature heating operations11 |
|---|
| Adjusting the heating curve |
| С |
| Changing the clock program for hea- |
| ting/D.H.W mode26 |
| Checking the clock program for hea- |
| ting/D.H.W. mode26 |
| Cooperation of the standard and the |
| individual D.H.W. clock |
| program24 |

Diank

| D |
|-----------------------------------|
| Display and change the individual |
| D.H.W. clock programm29 |
| Displaying temperatures and |
| values21 |
| Displaying the controller output |
| ports20 |
| |

Ε

| Error | message | | 35 |
|-------|---------|------|----|
| | | | |

L Locking11

| М |
|---------------------------------|
| Measuring of emissions (chimney |
| sweep service)12 |

Ο

| Overview of displa | ys4 |
|--------------------|-----|
|--------------------|-----|

Q

| Query operating data | |
|----------------------|--|
|----------------------|--|

R

Reload of standard clock programs preset at the factory25

Dok. Nr. 112648 33/2010

S

| Safety instructions7 |
|--|
| Selecting an operating mode 10 |
| Set values and actual values 22 |
| Setting the automatic programs for |
| heating/D.H.W |
| Setting the circulation pump clock |
| program29 |
| Setting the date 16 |
| Setting the heating limit (summer/win- |
| ter) 19 |
| Setting the maximum supply tempe- |
| rature 19 |
| Setting the room temperature for |
| night reduction heating mode 17 |
| Setting the room temperature heating |
| mode16 |
| Setting the time (clock)15 |
| Setting the vacation program 30 |
| Setting the warm water |
| temperature17 |
| Switching on the party function 15 |
| Switching output functions on |
| and off 33 |
| |

Т

Transfer the value to the standard display (1st level) 22

U

Unlock during error message (TEM firing automatic) 14

۷

| Vacation program | 30 |
|------------------|-----------------|
| Vacation program | display/change/ |
| terminate | |

Manufacture or distribution:



OEG GmbH Industriestrasse 1 D - 31840 Hess. Oldendorf Fon: 00800/63436624 Fax: 00800/63432924 http://www.oeg.net e-mail: info@oeg.net